


USE WITH EXISTING 13

FIG 3 "O" RING

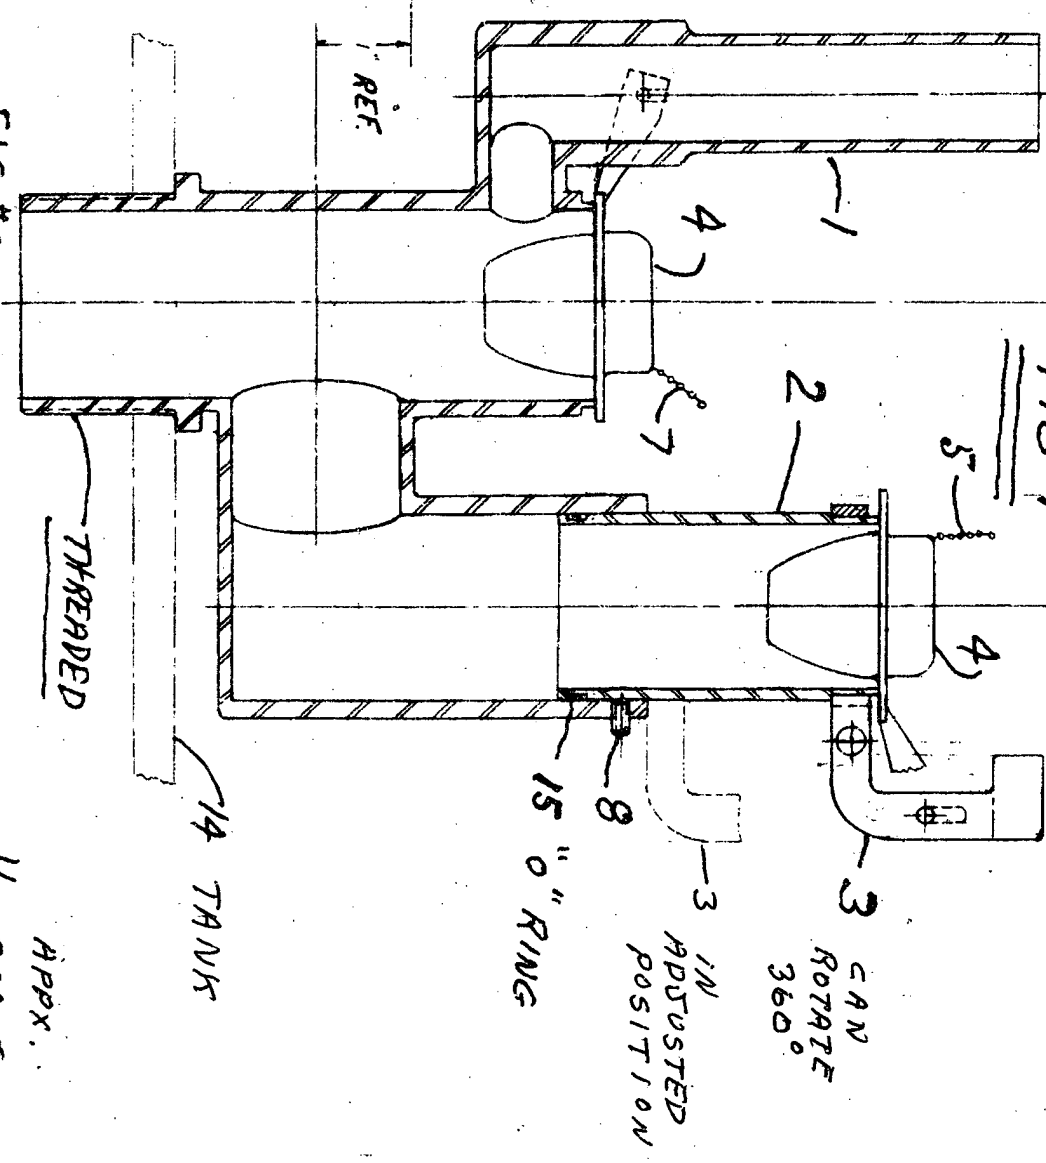

USE TO REPLACE EXISTING FLUSH VALVE OR NEW TANK

FIG 2 SEC A-A

APPR. 1/2 SCALE

FIG. 5 & FIG. 6 NOT REQUIRED  
ON NEW TANK CONSTRUCTION IF  
2<sup>ND</sup>. HANDLE HOLE IS ADDED IN  
NEW TANK. - COMMERCIAL  
HANDLES CAN THEN BE USED.

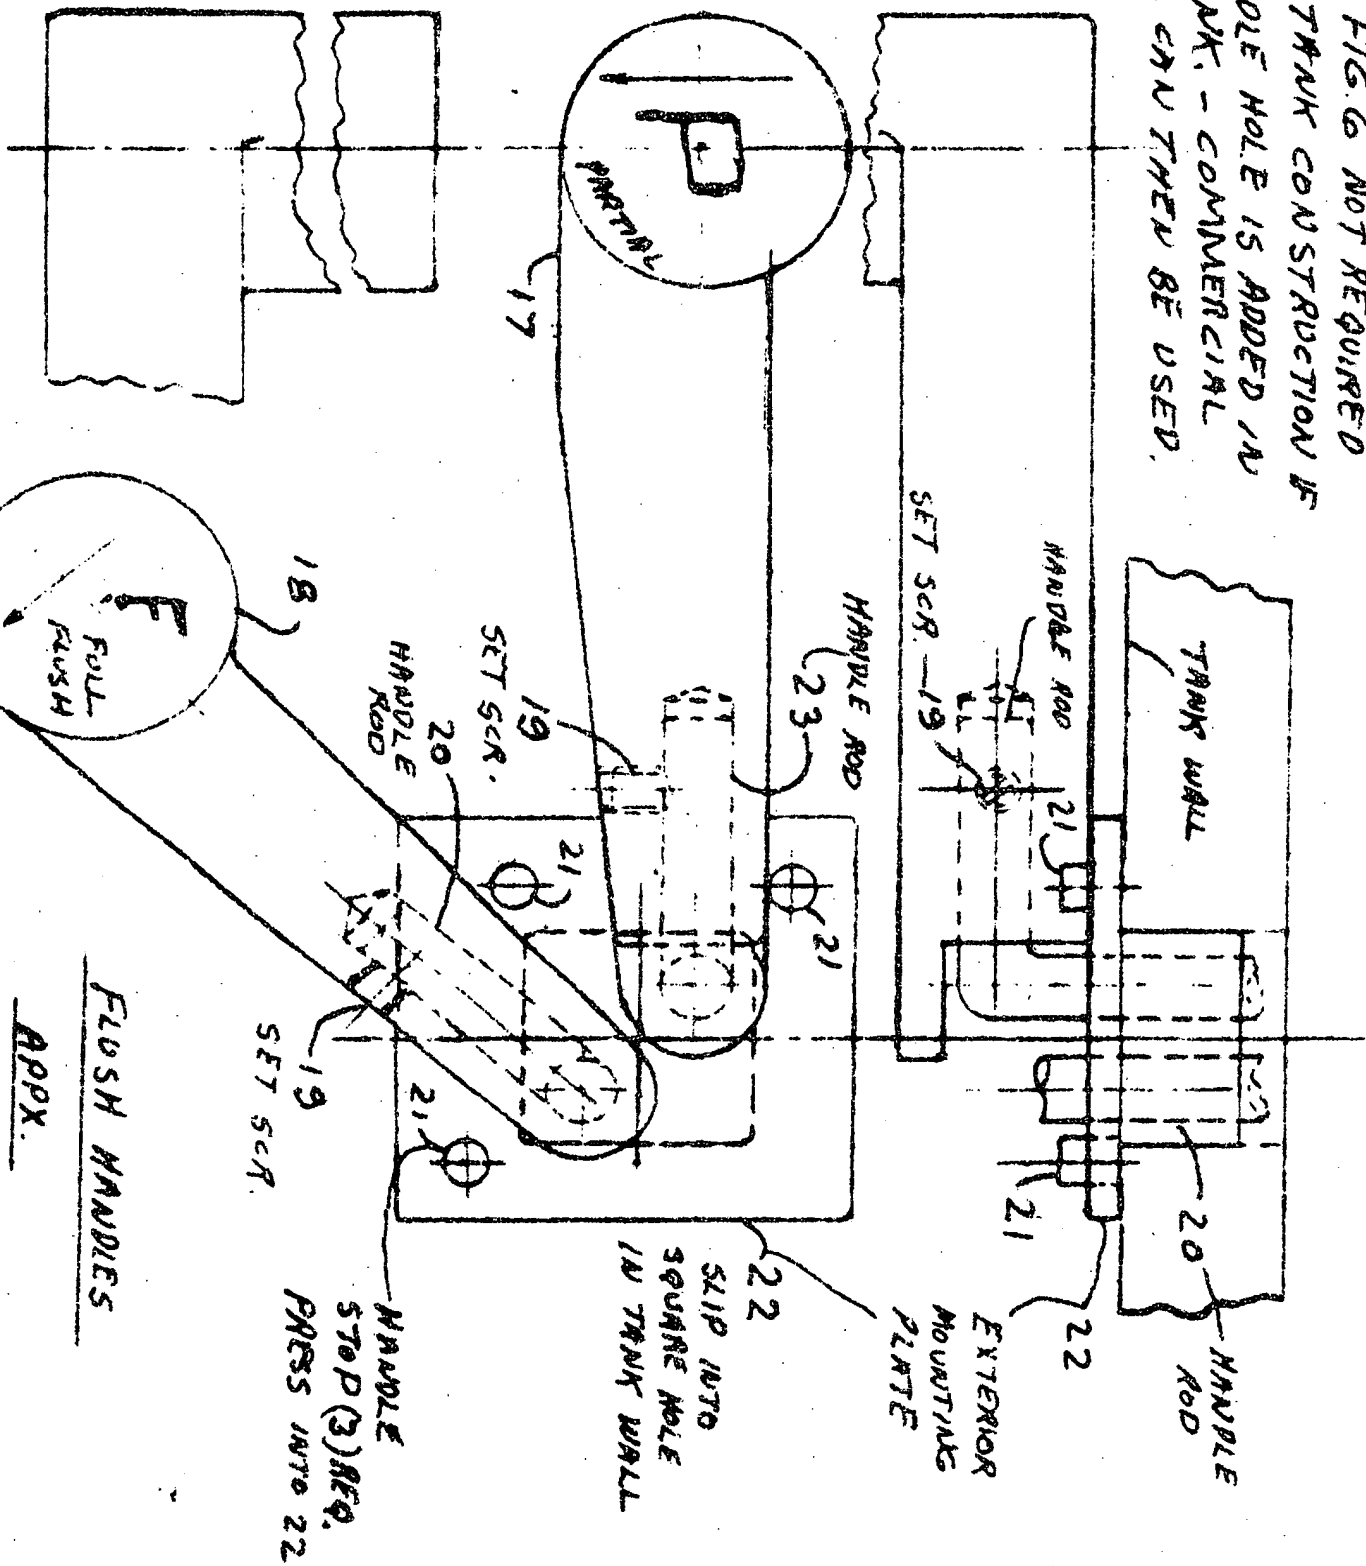


FIG. 5

FLOSH HANDLES

APPX.

2 X SCALE



APPROX. FULL SCALE